


SERVICES REQUIRED

- WATER..... (2) 2" WATER SUPPLY LINE @ 40 PSI MIN.
1-1/2" WATER SUPPLY LINE @ 40 PSI MIN. (WATER SOFTENER)
- ELECTRIC..... (1.) 480V/3PH/60HZ/125A SERVICE
(2.) 230V/1PH/60HZ/10A - R.O. UNIT
(3.) 120V/1PH/60HZ/10A - WATER SOFTENER
- AIR..... 1/2" SUPPLY LINE @ 80 PSIG MIN.
- PEAK LOAD..... 62 1/3 H.P.
- DRAIN..... 6" MINIMUM
- OVERHEAD CLEARANCE.... 16' -0"

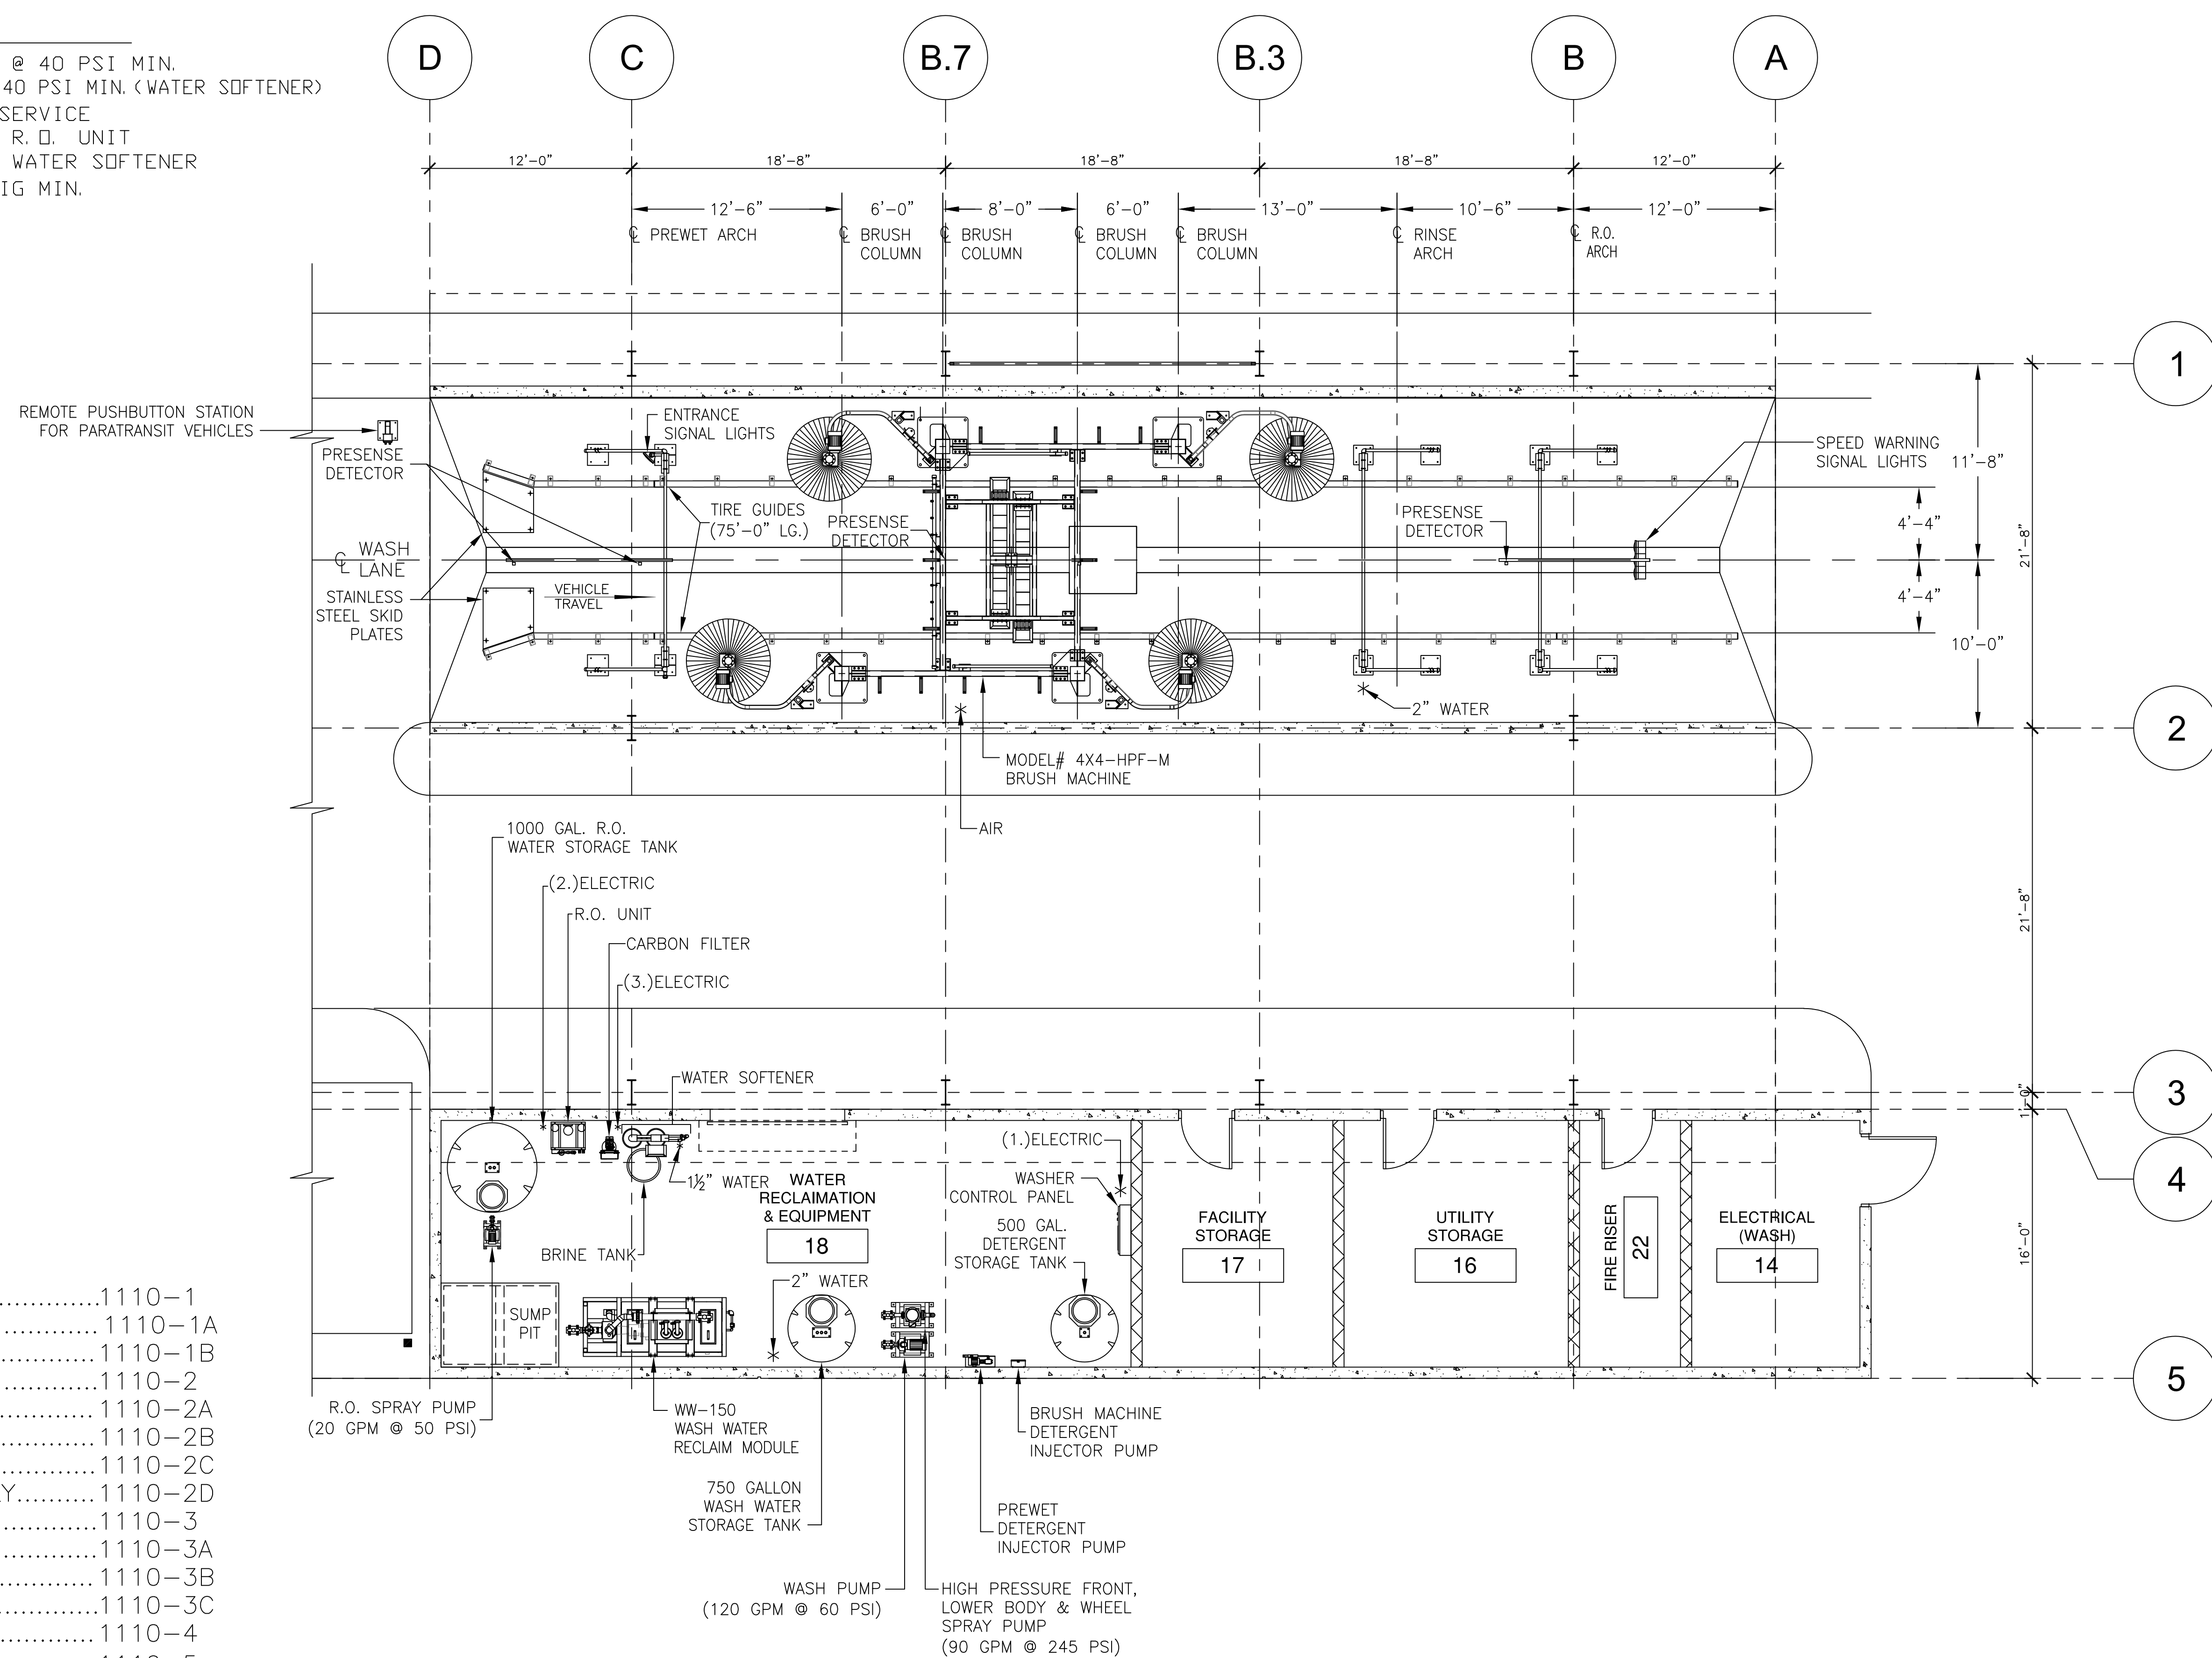

INSTALLATION DRAWINGS

- LAYOUT OF EQUIPMENT.....1110-1
- FOUNDATION BOLT LOCATION.....1110-1A
- TIRE GUIDE LOCATION & ASSEMBLY.....1110-1B
- FIELD PIPING SCHEMATIC.....1110-2
- WASH WATER STORAGE TANK SYSTEM.....1110-2A
- MODEL WW-150 RECLAIM MODULE ASSEMBLY.....1110-2B
- R.O. WATER STORAGE TANK & PUMP ASSEMBLY.....1110-2C
- DETERGENT STORAGE & INJECTION PUMP ASSEMBLY.....1110-2D
- PROGRAMMABLE CONTROLLER ASSEMBLY.....1110-3
- WASHER CONTROL PANEL ASSEMBLY.....1110-3A
- REMOTE PUSHBUTTON STATION.....1110-3B
- FIELD CONDUIT SCHEMATIC.....1110-3C
- CANTED PREWET ARCH ASSEMBLY.....1110-4
- MODEL #4X4-HPF-M BRUSH MACHINE ASSEMBLY.....1110-5
- BRUSH MACHINE DETAILS.....1110-5A
- BRUSH MACHINE FACTORY PIPING SCHEMATIC.....1110-5B
- BRUSH MACHINE FACTORY WIRING SCHEMATIC.....1110-5C
- CENTRALIZED BEARING LUBRICATION SYSTEM.....1110-5D
- LIMIT SWITCH ASSEMBLY & CONNECTION DIAGRAM.....1110-5E
- AIR CONTROL PANEL ASSEMBLY.....1110-5F
- CANTED RINSE ARCH ASSEMBLY.....1110-6
- CANTED R.O. ARCH ASSEMBLY.....1110-7
- PRESENCE DETECTOR LOCATION & CONNECTION DIAGRAM..1110-8

PLAN VIEW
LAYOUT OF EQUIPMENT

NOTE: THIS DRAWING IN DESIGN IS THE PROPERTY OF THE ROSS AND WHITE COMPANY AND MUST NOT BE COPIED OR USED EITHER DIRECTLY OR INDIRECTLY FOR ANY WORK OTHER THAN THAT OF THE ROSS AND WHITE COMPANY WITHOUT SAID COMPANY'S EXPRESSED PERMISSION. ALL RIGHTS OF INVENTION OR DESIGN ARE RESERVED.

REV	REVISION	DATE	REV	REVISION	DATE
E			A	GENERAL	1/4/12
F			B		
G			C		
H			D		
I			DRAWN BY: TMK DATE DRAWN: 12/22/11		
J			DATE PLOTTED: SCALE: 3/16"=1'-0" APPROVED:		
K			CHECKED BY: DATE CHECKED:		



LAYOUT OF EQUIPMENT

1110-1